




WIS module primary NDP-KE2-8E2-FP

- 8 channels
- 9 outputs
- LEDs for display of the output states and communication
- Deactivation option
- Housing with removable terminals
- DIN rail mounting
- For connection of 1 transmitter head
- Can only be used in conjunction with NDP20-FP series WIS transmitter

Inductive transmitter system



Dimensions

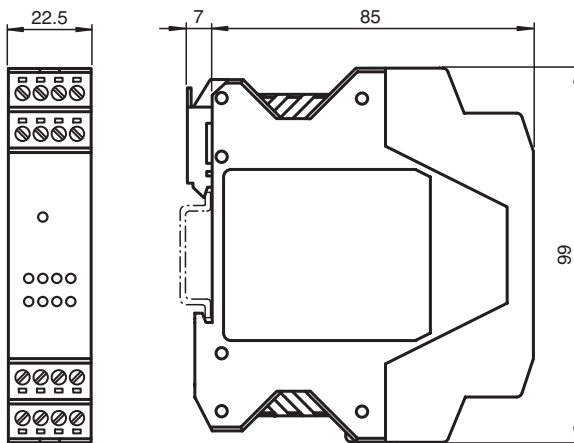

Technical Data

Nominal ratings			
Operating voltage	U_B	24 V DC \pm 10 %	
Number of signal channels		8	
Signal transfer direction		from secondary side to primary side	
Reverse polarity protection		reverse polarity protected	
Current consumption		max. 1000 mA	
Functional safety related parameters			
MTTF _d		245 a	
Mission Time (T _M)		20 a	
Diagnostic Coverage (DC)		0 %	
Indicators/operating means			
Switching state		8 x LED, yellow	
Transfer indicator	Tx	LED, green	
Input			
Number		1	
Input type		Activation input signal level: \geq 15 V = active, \leq 3 V inactive	

Release date: 2022-05-23 Date of issue: 2022-05-23 Filename: 221418_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0001
fa-info@us.pepperl-fuchs.com

Germany: +49 621 776 1111
fa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
fa-info@sg.pepperl-fuchs.com


PEPPERL+FUCHS

Technical Data



Input current		≤ 1 mA
Internal resistor		≥ 15 kΩ
Output		
Output type		1 Status output (high with proper transfer) and 8 Switch outputs PNP, NO. (switched high) , overload and short-circuit resistant
Voltage drop	U_d	≤ 2.5 V
Load current		max. 50 mA
Response time		≤ 200 ms (static operation , the transmission heads stand opposite to each other)
Compliance with standards and directives		
Directive conformity		
EMC Directive 89/336/EEC		EN 61000-6-2:2001, EN 61000-6-4:2001, EN 50295:1999
Standard conformity		
Standards		EN 60947-5-2:2007 IEC 60947-5-2:2007
Approvals and certificates		
CCC approval		CCC approval / marking not required for products rated ≤36 V
Ambient conditions		
Ambient temperature		0 ... 50 °C (32 ... 122 °F)
Storage temperature		-25 ... 85 °C (-13 ... 185 °F)
Mechanical specifications		
Degree of protection		IP20
Material		
Housing		PA 66-FR
Installation		DIN rail mounting
Mass		106 g
General information		
Note		Maximum cable length between WIS module and WIS transmitter must not exceed 5 m.

Connection

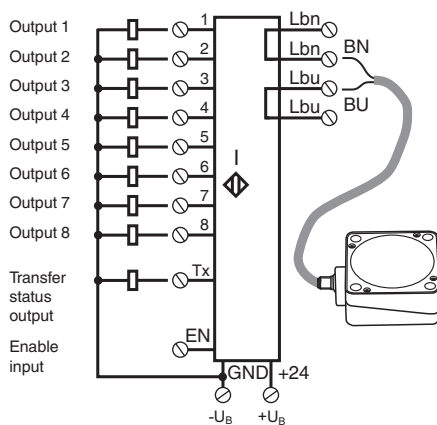Connection:




Matching System Components

	NDP20-FP-V1	Inductive transmitter system
	NDS20-FP-V1	Inductive transmitter system

Release date: 2022-05-23 Date of issue: 2022-05-23 Filename: 221418_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Matching System Components

	NDS-F146-8E2-V1	Inductive transmitter system
-----------------------------------------------------------------------------------	------------------------	------------------------------

Release date: 2022-05-23 Date of issue: 2022-05-23 Filename: 221418_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0001
fa-info@us.pepperl-fuchs.com

Germany: +49 621 776 1111
fa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
fa-info@sg.pepperl-fuchs.com

Function

Functional description

A WIS (wireless inductive system) inductive transfer system always consists of the following four components:


- WIS primary module
- WIS primary transmitter
- WIS secondary transmitter
- WIS secondary module

The WIS primary module is installed in the stationary component and is connected to a downstream control (i.e., PLC). The WIS primary transmitter connected to the WIS primary module. The WIS secondary transmitter and the WIS secondary module that is connected to it are installed in the moveable part of the component. The WIS secondary module disposes of connection capabilities for several sensors. If the two transmitters are located in front of each other within the system range, then electric power is transferred from the primary side to the secondary side. The sensors attached to the WIS secondary module are now supplied with electric energy and begin to operate. The sensor output signals are transmitted in the opposite direction from the secondary side to the primary side and are separately available on the WIS primary module output terminals for further processing by the equipment control. The sensor signal status is also displayed by LEDs that correspond to the sensor channels. A separate output signal Tx on the WIS primary module indicates the communication status. A high signal indicates communication between the WIS transmitters. This is also indicated by a glowing LED Tx.

Power transfer and communication in the system can be activated and deactivated on the WIS primary module with the EN input .

Input signal on EN	Function
+ UB (24 V DC)	Transfer activated
GND or open.	Transfer deactivated

Function schematic

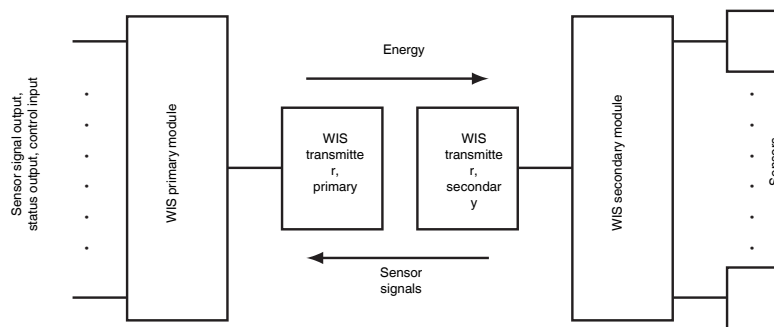

The sum of the currents of all sensors attached to the WIS secondary module must not be greater than the maximum transferable current. This is calculated by dividing the transferable power by the 12 V provided by the transmitters.

Release date: 2022-05-23 Date of issue: 2022-05-23 Filename: 221418_eng.pdf