


Connections


NON-HAZARDOUS LOCATION or
HAZARDOUS LOCATION
Class I, Division 1, Groups A, B, C, D
Class II, Division 1, Groups E, F, G
Class III, Division 1 or
Class I, Zone 0 and 1, IIC
Zone 20 and 21, IIIC

NON-HAZARDOUS LOCATION or
HAZARDOUS LOCATION
Class I, Division 2, Groups A, B, C, D or
Class I, Zone 2, IIC

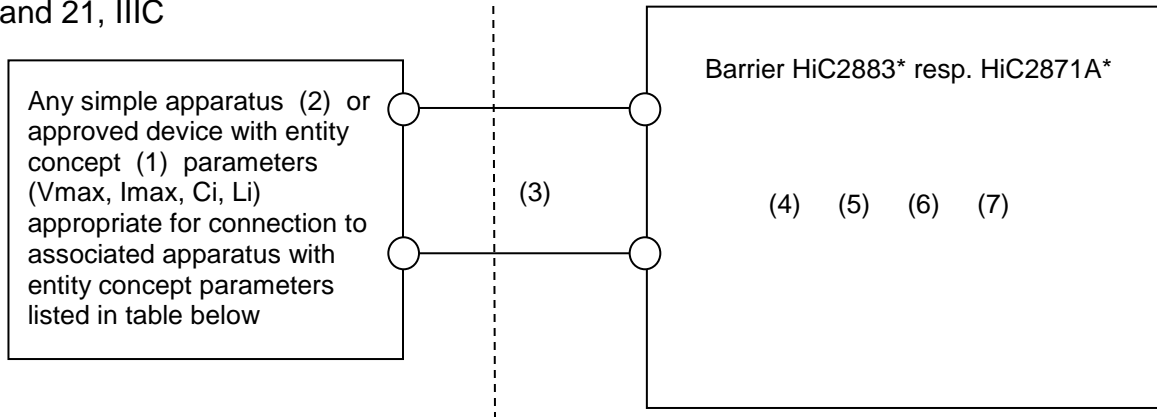

Notes

1. The Entity Concept allows interconnection of intrinsically safe apparatus with associated apparatus not specifically examined in combination as a system when the approved values of V_{oc} (or U_o) and I_{sc} (or I_o) for the associated apparatus are less than or equal to V_{max} (U_i) and I_{max} (I_i) for the intrinsically safe apparatus and the approved values of C_a (C_o) and L_a (L_o) for the associated apparatus are greater than $C_i + C_{cable}$ and $L_i + L_{cable}$, respectively, for the intrinsically safe apparatus,
Where $C_{cable} = 60\text{pF/ft}$ if unknown
Where $L_{cable} = 0.20\text{uH/ft}$ if unknown
2. Simple apparatus: an electrical component or combination of components of simple construction with well-defined electrical parameters that does not generate more than 1.5 V, 100mA, 25mW, or is a passive component that does not dissipate more than 1.3W and is compatible with the intrinsic safety of the circuit in which it is used.
3. Wiring methods must be in accordance with all applicable installation requirements of the country in use. For US, this is NFPA 70 (NEC) article 504 with additional information in ANSI-ISA –RP12.06.01. For Canada this is CSA 22.1-12 (CEC) section 18 and appendix F.
4. Barriers shall not be connected to any device which uses or generates internally any voltage in excess of 60V unless the device has been determined to adequately isolate the voltage from the barrier.
5. The barriers are rated `non-incendive` for use in Class I, Division 2 or Zone 2. A temperature rating of T4 applies to all non-incendive rated barriers.
6. The permitted ambient temperature range -40°C to $+70^{\circ}\text{C}$.
7. Specific Conditions of Use:
 - a. If the barriers are intended to be mounted in a Zone 2 location, they shall be mounted within a tool-secured enclosure which is capable of accepting one or more of the Class I, Zone 2 wiring methods specified in the National Electrical Code (ANSI/NFPA 70) or Canadian Electrical Code (C22.1), as applicable. The equipment shall be installed in an AEx or Ex certified IP54 enclosure unless the apparatus is intended to be afforded an equivalent degree of protection by location.

| | | |
|--|---------------------------------------|-------------------|
| This document contains safety-relevant information. It must not be altered without the authorization of a NE EX | | |
| | Only valid as long as released in EDM | date: 2021-Sep-01 |
|  PEPPERL+FUCHS Global | FM Control drawing | 116-0442A |
| | HiC2883*, HiC2871A* | sheet 1 of 2 |

- b. If the barriers are intended to be mounted in a Division 2 location, they shall be mounted within a tool-secured enclosure which is capable of accepting one or more of the Class I, Division 2 wiring methods specified in the National Electrical Code (ANSI/NFPA 70) or Canadian Electrical Code (C22.1), as applicable. The equipment shall be installed in an enclosure with a minimum ingress protection of IP2X.
- c. For Zone installations, ensure protection of supply terminals against transient voltages exceeding 140% of the rated supply voltage.
- d. HiC2871A* and HiC2883* module installations shall be protected to achieve a pollution degree of 2 or lower.

Entity Parameters

| Model Number | Terminals | U _o (V) | I _o (mA) | P _o (mW) | C _o (nF) | | | L _o (mH) | | |
|--------------|-----------|-----------------------|------------------------|------------------------|---------------------|----------------------|----------|---------------------|----------------|----------|
| | | | | | A,B IIC | C,E,F,G IIB, IIIC | D IIA | A,B IIC | C,E,F,G IIB | D IIA |
| HiC2883* | 5a, 5b | 26 | 110 | 715 | 99 | 770 | 2600 | 2,9 | 11,7 | 23,5 |
| HiC2871A* | | | | | | | | | | |

The values of L_o and C_o listed in the table above are allowed if one of the following conditions is met:

- the total L_i of the external circuit (excluding the cable) is < 1% of the L_o value or
- the total C_i of the external circuit (excluding the cable) is < 1% of the C_o value.

The values of L_o and C_o listed in the table above shall be reduced to 50% when both of the following conditions are met:

- the total L_i of the external circuit (excluding the cable) is ≥ 1% of the L_o value and
- the total C_i of the external circuit (excluding the cable) is ≥ 1% of the C_o value.


Note: the reduced capacitance of the external circuit (including cable) shall not be greater than 1µF for IIA, IIB/IIIC and 600nF for IIC.

WARNING - Substitution of components may impair intrinsic safety and suitability for use in Class I, Div. 2/Zone 2.

AVERTISSEMENT - La substitution de composants peut compromettre la sécurité intrinsèque et l'adéquation à une utilisation en Classe I, Div. 2/Zone 2.

WARNING - Do not disconnect the equipment or actuate switches when the equipment is energized and an explosive atmosphere is present.

AVERTISSEMENT - Ne pas débrancher l'équipement et ne pas actionner les commutateurs lorsque l'équipement est sous tension et exposé à une atmosphère explosive.

| | | |
|---|---------------------------------------|-------------------|
| This document contains safety-relevant information. It must not be altered without the authorization of a NE EX | | |
| | Only valid as long as released in EDM | date: 2021-Sep-01 |
|  PEPPERL+FUCHS | FM Control drawing | 116-0442A |
| | HiC2883*, HiC2871A* | sheet 2 of 2 |
| Global | | |