PMI14V-F112-...-U-...

F112 Inductive Positioning System

Manual



CE

Your automation, our passion.

PEPPERL+FUCHS

With regard to the supply of products, the current issue of the following document is applicable: The General Terms of Delivery for Products and Services of the Electrical Industry, published by the Central Association of the Electrical Industry (Zentralverband Elektrotechnik und Elektroindustrie (ZVEI) e.V.) in its most recent version as well as the supplementary clause: "Expanded reservation of proprietorship"

Worldwide

Pepperl+Fuchs Group

Lilienthalstr. 200

68307 Mannheim

Germany

Phone: +49 621 776 - 0

E-mail: info@de.pepperl-fuchs.com

North American Headquarters

Pepperl+Fuchs Inc.

1600 Enterprise Parkway

Twinsburg, Ohio 44087

USA

Phone: +1 330 425-3555

E-mail: sales@us.pepperl-fuchs.com

Asia Headquarters

Pepperl+Fuchs Pte. Ltd.

P+F Building

18 Ayer Rajah Crescent

Singapore 139942

Phone: +65 6779-9091

E-mail: sales@sg.pepperl-fuchs.com

https://www.pepperl-fuchs.com

1 Introduction 4
2 Declaration of Conformity 5
3 Safety 6
3.1 Symbols Used 6
3.2 Intended Use 6
3.3 General safety instructions 7
4 Product Description 8
4.1 Use and Application 8
4.2 Accessories 9
4.2.1 Damping Elements 9
4.2.2 Connection Cable with Plug, 3-Wire 10
5 Installation 11
5.1 Safety Information 11
5.2 Measuring Range of the PMI14V-...-U-... 11
5.3 Preparation 13
5.4 Mounting 13
5.5 Connection 14
6 Commissioning 15
6.1 Commissioning in Line with Default Settings 15
6.2 Programming the Measuring Range 15
6.3 Troubleshooting during Teach-in 16
7 Maintenance and Repair 17
7.1 Maintenance 17
8 Troubleshooting 18
8.1 What to Do in the Event of a Fault 18

2025-02

1 Introduction

Congratulations

You have chosen a device manufactured by Pepperl+Fuchs. Pepperl+Fuchs develops, produces and distributes electronic sensors and interface modules for the market of automation technology on a worldwide scale.

Please read the operating instructions carefully before installing this device and putting it into operation. The instructions and notes contained in this document will guide you step-by-step through the installation and commissioning procedures to ensure trouble-free use of this product. By doing so, you:

- Guarantee safe operation of the device
- Can utilize the entire range of device functions
- Avoid faulty operation and associated errors
- Reduce costs associated with downtime and incidental repairs
- Increase the effectiveness and operating efficiency of your plant.

Note

Store these instructions somewhere safe in order to have them available for future work on the device.

Contact

If you have any questions about the device, its functions, or accessories, please contact us at:

Pepperl+Fuchs Group
Lilienthalstraße 200
68307 Mannheim, Germany
Telephone: +49 (0)621 776-1111
Fax: +49 (0)621 776-271111
Email: fa-info@de.pepperl-fuchs.com

2025-02

2 Declaration of Conformity

This product was developed and manufactured in line with the applicable European standards and directives.

Note

A declaration of conformity can be requested from the manufacturer.

The product manufacturer, Pepperl+Fuchs Group, 68307 Mannheim, Germany, has a certified quality assurance system that conforms to ISO 9001.

ISO**9001**

3 Safety

3.1 Symbols Used

Safety-Relevant Symbols



Danger!
This symbol indicates an imminent danger.
Non-observance will result in personal injury or death.



Warning!
This symbol indicates a possible fault or danger.
Non-observance may cause personal injury or serious property damage.



Caution!
This symbol indicates a possible fault.
Non-observance could interrupt the device and any connected systems and plants, or result in their complete failure.

Informative Symbols



Note
This symbol brings important information to your attention.



Action

1. This symbol indicates a paragraph with instructions. You are prompted to perform an action or a sequence of actions.

3.2 Intended Use

The F112 inductive positioning system is optimized for highly accurate, continuous position detection. Based on the precise evaluation of several coil systems, the device combines a proven inductive sensor with innovative microcontroller technology. The compact design of the F112 enables position detection tasks to be carried out in a noncontact, wear-free process to a measuring length of 14 mm, even in confined installation locations.



Note
The optimum measurement accuracy is achieved at an actuator distance of 1 mm ... 2 mm.

Only use recommended original accessories.

3.3 General safety instructions

Responsibility for planning, assembly, commissioning, operation, maintenance, and dismounting lies with the plant operator.

Installation and commissioning of all devices may be performed only by trained and qualified personnel.

It is dangerous for the user to make changes and/or repairs. Additionally, doing so voids the warranty and excludes the manufacturer from any liability. In the event of any serious errors, stop using the device. Secure the device against unintended operation. To have the device repaired, return it to your local Pepperl+Fuchs representative or your sales center.

Note

Disposal

Electronic waste is dangerous. When disposing of the equipment, observe the current statutory requirements in the relevant country of use and local regulations.

4 Product Description

4.1 Use and Application

The PMI14V-F112-...-U-... inductive positioning system is optimized for highly accurate, continuous position detection.

Based on the precise evaluation of several coil systems, the device combines a proven inductive sensor with innovative microcontroller technology.

The compact design of the F112 enables position detection tasks to be carried out in a noncontact and wear-free process to a measuring length of 14 mm. This includes installation locations where space is limited.

With its integrated temperature compensation feature, the inductive positioning system is ideal for use in harsh environments and for critical positioning tasks.

Due to the inductive functional principle, ferrites or magnets are not necessary as a counterpart. As is the case with an inductive proximity switch, the damping element can be made of any type of metal.

The benefits of the PMI14V-F112-...-U-... inductive positioning system include:

- High resolution and accuracy
- Minimal temperature drift
- Noncontact operation
- Measuring range that can be taught in
- Minimal susceptibility to interference due to the inductive functional principle

The PMI14V-F112-...-U-... inductive positioning system delivers a voltage signal between 0 V ... 10 V at the output that is proportional to the position of the damping element.

4.2 Accessories


Various accessories are available.

4.2.1 Damping Elements

We recommend using either the BT-F90-W or BT-F90-G damping element.


BT-F90-W Material: ST37 steel



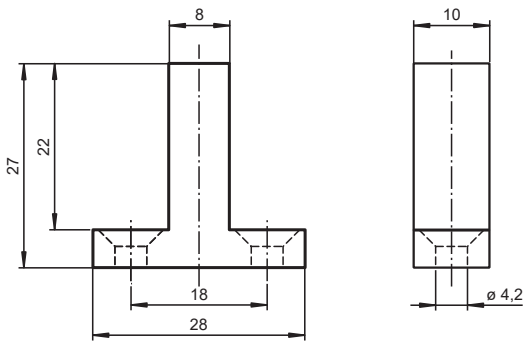

BT-F90-G Material: ST37 steel



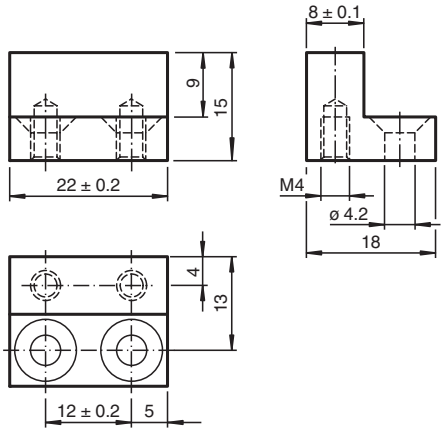

Using Your Own Damping Element
In principle, it is possible to use your own damping element. The damping element must have the following properties to be able to make use of the sensor's specified accuracy:
Material: construction steel such as S235JR+AR (previously St37-2)
Dimensions as per BT-F90-W (L x W x H): ≥ 18 mm x 8 mm x ≥ 4 mm

Alternatively, the element must have the same dimensions as the BT-F90-G damping element.

Note

The exact width of the damping element of 8 mm must be observed. If the width of the damping element deviates from this value, the position values will differ.

4.2.2 Connection Cable with Plug, 3-Wire

Below is a list of 3-wire female single-ended cordsets with a core cross-section of 3 x 0.25 m^2 suitable for establishing the electrical connection for PMI14V-F112-...-U-... devices:

Type	Straight	Right angle	Cable Lengths
V3-GM-2M-PVC	X		2 m
V3-WM-2M-PUR	X		2 m
V3-GM-5M-PVC	X		5 m
V3-GM-5M-PUR	X		5 m
V3-WM-2M-PVC		X	2 m
V3-WM-2M-PUR		X	2 m
V3-WM-5M-PVC		X	5 m
V3-WM-5M-PUR		X	5 m

Other lengths on request.

5 Installation

5.1 Safety Information

Caution!

Risk of short circuit

Carrying out work while the system is energized may result in damage to the device.

- Always disconnect the supply voltage before carrying out work on the device.
- Only connect the device to the supply voltage once all work has been completed.

5.2 Measuring Range of the PMI14V-...-U-...

General

On delivery, the measuring range of the PMI14V-F112-...-U-... is 14 mm. This is indicated by the framed area at the front of the inductive positioning system.

It is possible to reduce the measuring range by parameterizing the sensor. When adjusting the measuring range, the end point of the sensor is fixed; it is the starting point of the measuring range that can be changed.

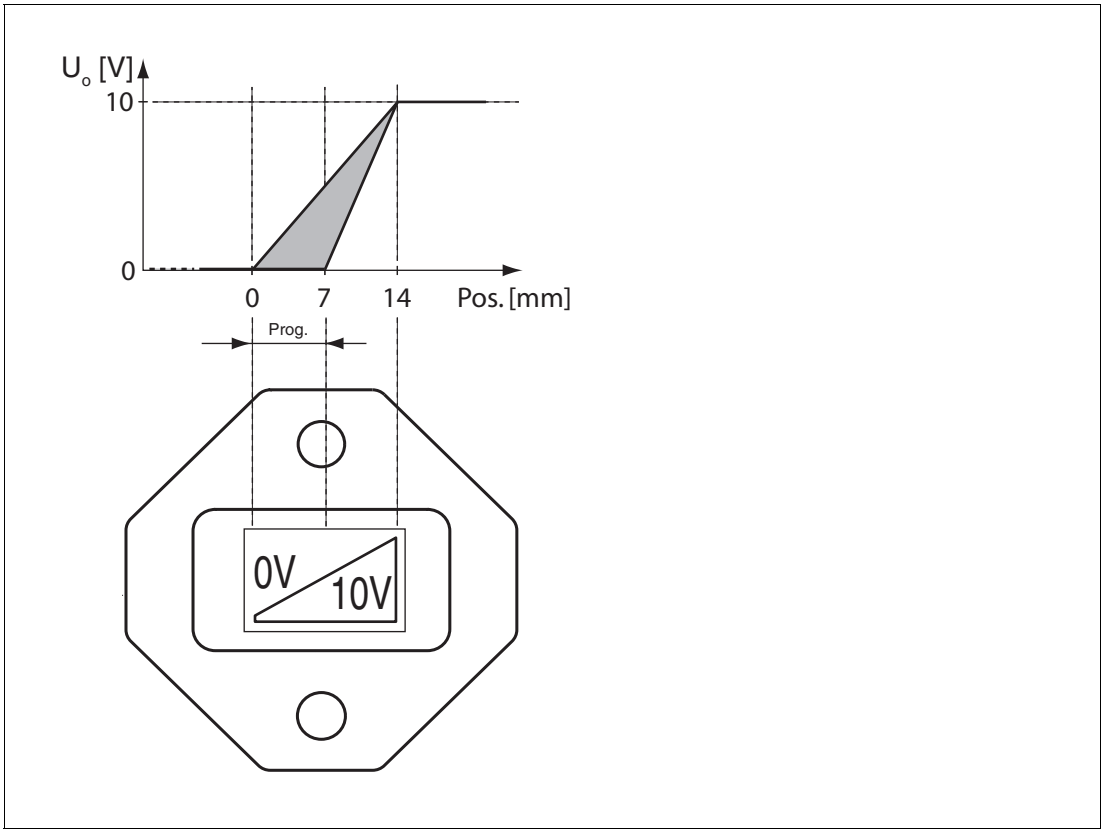


Figure 5.1

U_0 [V] Voltage at the analog output in volts

Pos. [mm] Position of the actuator in mm

The starting point can be taught in within a range of 0 mm to 7 mm

Definition of the Measuring Range/Position

The position of the damping element defined by the positioning system relates to half of the width (center) of the damping element. The measuring range begins and ends with the half coverage provided by the damping element when moving lengthwise.

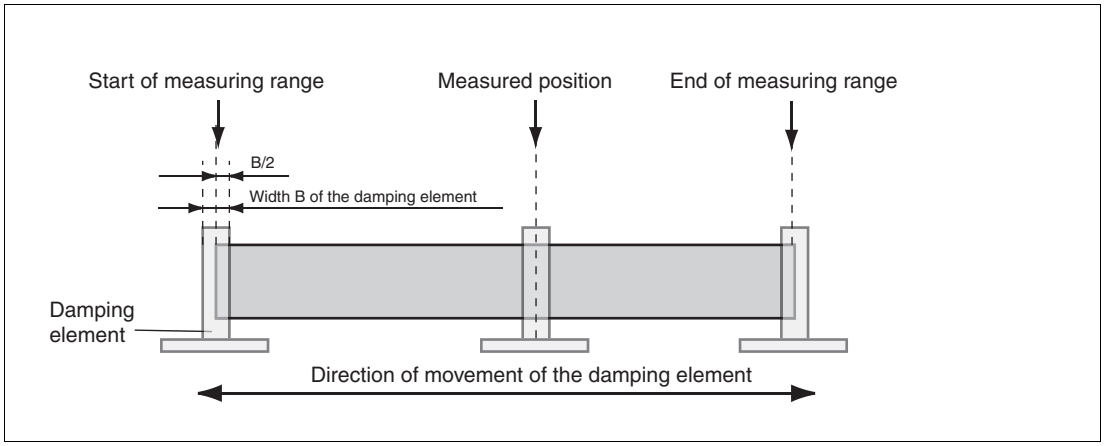


Figure 5.2

Operating Instructions

If the damping element leaves the detection range of the positioning system, the last valid value is retained at the voltage output until the damping element enters the valid area again. This is illustrated in the figure below.

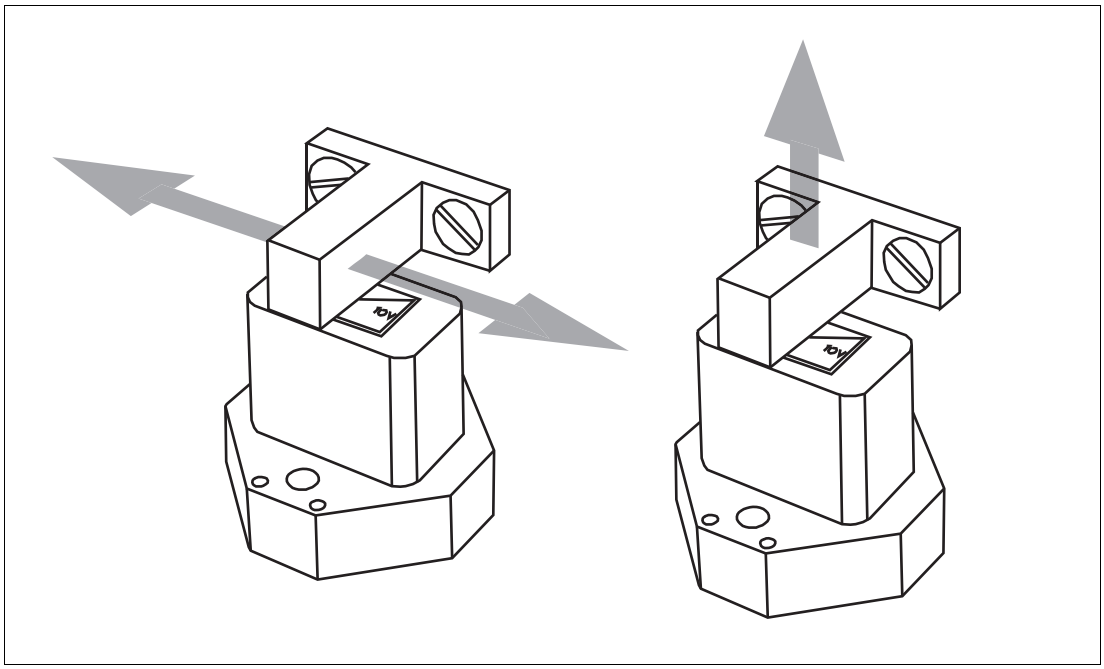


Figure 5.3

5.3 Preparation

Unpacking the Device

1. Check the packaging and contents for damage.

   ↳ In the event of damage, inform the shipping company and notify the supplier.

2. Check the package contents against your order and the shipping documents to ensure that all items are present and correct.


   ↳ Should you have any questions, direct them to Pepperl+Fuchs.

3. Retain the original packaging in case the device is to be stored or shipped again at a later date.

5.4 Mounting

- A flush mount is possible in metallic and nonmetallic environments
- The distance between the measuring field (framed area at the front of the sensor) and the mounting base or fastening screws on the damping element must be at least 3 mm.
  Watch out for any protruding metal parts such as screw heads when mounting the device.
- The damping element must be attached to the sensor at a right angle to guarantee the relevant measurement accuracy.
- The distance between the damping element and the sensor can be a maximum of 2.5 mm and must be at least 1 mm.

Distance of the Damping Element

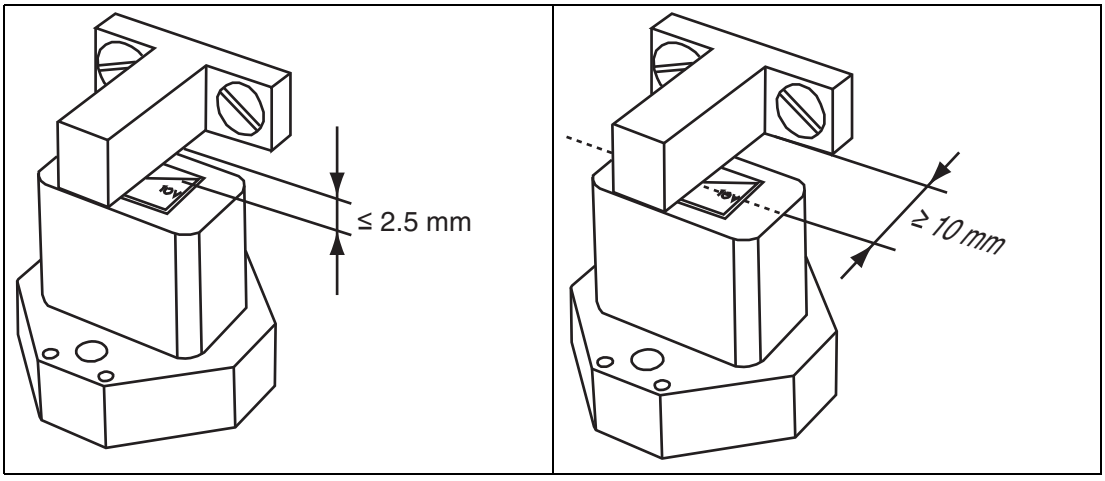

5.5 Connection



Connecting the Supply Voltage

To supply voltage to the sensor, proceed as follows:

1. Insert the prepared connection cable into the connector plug provided for this purpose on the underside of the housing.
2. Screw the cap nut onto the connector plug as far as it will go. This ensures that the power cable cannot be inadvertently pulled out.
3. Now connect the supply voltage to the cable provided.

↳ The sensor is now ready for operation.

2025-02

6 Commissioning

6.1 Commissioning in Line with Default Settings

1. Check that the distance between the damping element and the sensor is correct.
2. Switch on the supply voltage. The operating indicator on the sensor lights up yellow.

↳ The sensor will now function using the default parameters.

6.2 Programming the Measuring Range

Operating and Display Elements

The PMI14V-F112-...-U-... inductive positioning system features a small, slightly recessed push button (1) on the back that is used to program the measuring range.

The measuring range starting point that is taught in is saved in the internal nonvolatile memory. This ensures that the value remains available even if the power supply is disconnected.

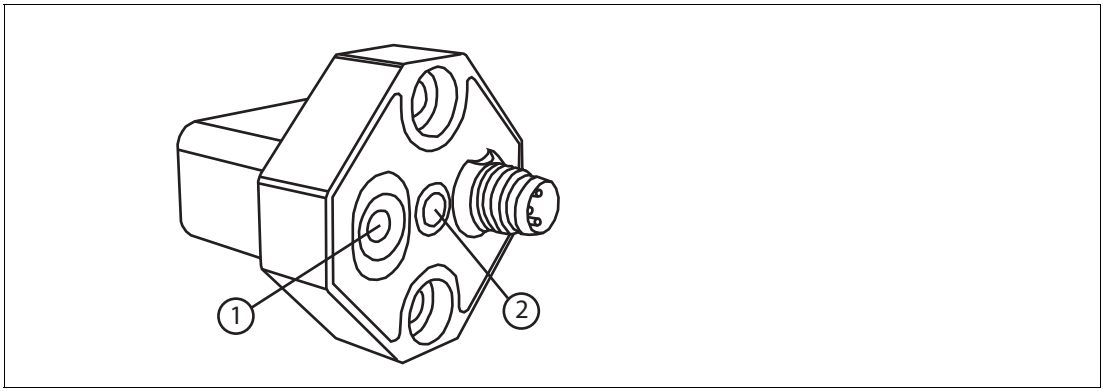


Figure 6.1

1 Push button for programming the measuring range

2 Operating display: LED (yellow/red)

Teaching in the Measuring Range

1. Position the damping element for position detection at the measuring range starting point to be taught in. The geometric center of the damping element is crucial here.
2. Press and hold the push button with a thin object for at least 2 seconds. When doing so, make sure that the damping element does not move.

↳ The LED flashes yellow to indicate that the inductive positioning system is in Teach-in mode. If the LED is not flashing yellow or flashes red, read the section "Troubleshooting during Teach-in".

3. Confirm the taught-in starting point by pressing the push button again.

↳ If the now yellow LED lights up continuously, the starting point has been taught in. The end point of the measuring range remains unchanged. This point is marked by the area labeled "10 V" on the front. If the LED flashes red, read the section "Troubleshooting during Teach-in".

Note

Cancelation if Starting Point Not Confirmed

If the starting point that has been taught in is not confirmed within 120 seconds, the inductive positioning system exits "Teach-in mode" and continues operation using the previous value.

6.3 Troubleshooting during Teach-in

After pressing the push button once, the LED continues to light up yellow

If there is no damping element in the defined detection range of the inductive positioning system, the device does not switch to "Teach-in mode".

Remedy: Position the damping element at the measuring range starting point at a maximum distance of 2.5 mm.

After pressing the push button once, the LED flashes red

The damping element is located within the detection range of the inductive positioning system at a position that is not valid for the Teach-in process. The LED flashes red for 20 seconds. The sensor then returns to normal mode.

Remedy: Position the damping element within 0 mm ... 7 mm of the detection range. This is the area within which you can teach in the measuring range starting point.

In Teach-in mode, the LED changes from flashing yellow to flashing red

When calling up Teach-in mode, the damping element was in a valid position. Before the measuring range starting point had been confirmed, the damping element left the detection range of the inductive positioning system.

Remedy: Ensure that the damping element is not moved during the Teach-in process.

The LED flashes red after confirming the measuring range starting point

When calling up Teach-in mode, the damping element was in a valid position. Before the measuring range starting point had been confirmed, the damping element left the valid area for Teach-in at the measuring range starting point (0 mm … 7 mm).

Remedy: Ensure that the damping element is not moved during the Teach-in process.

2025-02

7 Maintenance and Repair

7.1 Maintenance

The sensor's transmission properties are stable over long periods. For this reason, regular adjustments to, and maintenance on the sensor itself, are not necessary. Nevertheless check in the course of normal maintenance intervals that the sensor, the actuator and the connector are securely attached. Also check that the connecting cable is intact and correctly routed.

8 Troubleshooting

8.1 What to Do in the Event of a Fault

Before requesting a service call, please check that the following actions have been taken:

- The customer has tested the system according to the checklist below.
- Telephone assistance has been sought from the Service Center to isolate the problem.

Checklist

Fault	Cause	Remedy
"Operating indicator" LED does not light up	The power supply is switched off.	Check whether there is a reason why the power supply is switched off (installation or maintenance work, etc.). Switch on the power supply if appropriate.
"Operating indicator" LED does not light up	The plug is not connected to the connector on the sensor.	Connect the plug to the sensor and tighten the cap nut by hand.
"Operating indicator" LED does not light up	Wiring fault in the splitter or switch cabinet.	Check the wiring carefully and repair any wiring faults.
"Operating indicator" LED does not light up	Supply cable to the sensor is damaged.	Replace the damaged cable.
Object is not detected	Sensor is too far away from the item to be detected	Check the mounting and, if necessary, adjust the sensor to the correct distance

- If none of the above actions solves the problem, contact the Pepperl+Fuchs Service Center. Have details of the model number and firmware version of the sensor ready if possible.

2025-02

Your automation, our passion.

Explosion Protection

- Intrinsic Safety Barriers
- Signal Conditioners
- FieldConnex® Fieldbus
- Remote I/O Systems
- Electrical Ex Equipment
- Purge and Pressurization
- Industrial HMI
- Mobile Computing and Communications
- HART Interface Solutions
- Surge Protection
- Wireless Solutions
- Level Measurement

Industrial Sensors

- Proximity Sensors
- Photoelectric Sensors
- Industrial Vision
- Ultrasonic Sensors
- Rotary Encoders
- Positioning Systems
- Inclination and Acceleration Sensors
- Fieldbus Modules
- AS-Interface
- Identification Systems
- Displays and Signal Processing
- Connectivity

Pepperl+Fuchs Quality
Download our latest policy here:

www.pepperl-fuchs.com/quality

PEPPERL+FUCHS

www.pepperl-fuchs.com

© Pepperl+Fuchs · Subject to modifications

/ DOCT-5019A