



# HART Output Isolator with Shutdown Input

## FB4205C2


- 4-channel
- Outputs Ex ia
- Installation in suitable enclosures in Zone 1
- Module can be exchanged under voltage (hot swap)
- Analog output module for 0/4 mA ... 20 mA
- HART communication via field bus or service bus
- Simulation mode for service operations (forcing)
- Line fault detection (LFD): one LED per channel
- Permanently self-monitoring
- Output with bus-independent safety shutdown



### Function

The device drives positioners, proportional valves, I/P converters, or local indicators. Open and short-circuit line faults are detected. The output can be switched off via a contact. This can be used for bus-independent safety applications. The output is galvanically isolated from the bus and the power supply.

### Connection

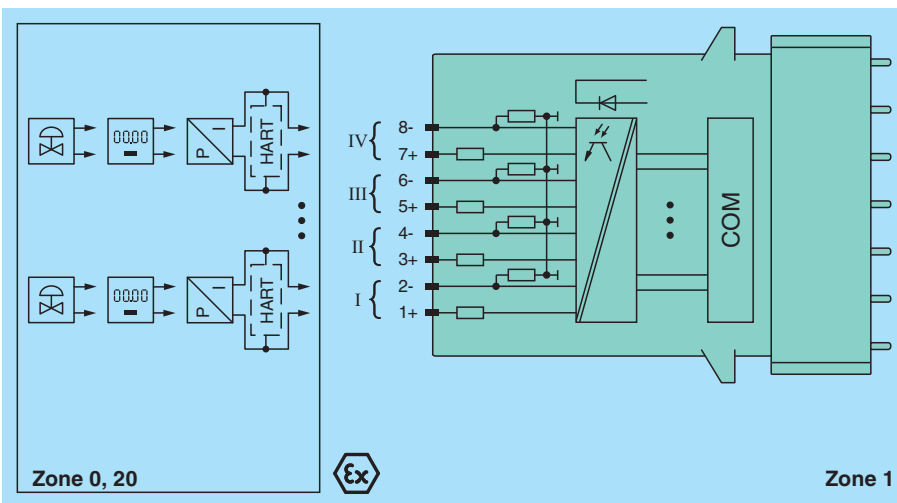

### Technical Data

#### Slots

Occupied slots 2

#### Functional safety related parameters

Safety Integrity Level (SIL) SIL 2

#### Supply

Connection	backplane bus	
Rated voltage	$U_r$	12 V DC , only in connection with the power supplies FB92**
Power dissipation	2.15 W	
Power consumption	3.3 W	

#### Internal bus

Release date: 2023-06-13 Date of issue: 2023-06-13 Filename: 239059\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group  
www.pepperl-fuchs.com

USA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com

**PEPPERL+FUCHS**

## Technical Data

Connection	backplane bus
Interface	manufacturer-specific bus to standard com unit
<b>Analog input</b>	
HART communication	yes
HART secondary variable	no
<b>Analog output</b>	
Number of channels	4
Suitable field devices	
Field device	Proportional Valve
Field device [2]	I/P converters
Field device [3]	on-site display
Connection	terminals 1+, 2-; 3+, 4-; 5+, 6-; 7+, 8-
Current	0 ... 20 mA short-circuit protected
Line fault detection	can be switched on/off for each channel via configuration tool , configurable via configuration tool
Short-circuit	No
Open-circuit	deviation of preset output value > 0.5 mA
Load	max. 750 Ω at 20 mA
HART communication	yes
HART secondary variable	yes
Watchdog	within 0.5 s the device goes in safe state, e.g. after loss of communication
<b>Transfer characteristics</b>	
Deviation	
After calibration	0.1 % of the signal range at 20 °C (68 °F)
Influence of ambient temperature	0.1 %/10 K of the signal range
Refresh time	100 ms
<b>Indicators/settings</b>	
LED indication	Power LED (P) green: supply Diagnostic LED (I) red: module fault , red flashing: communication error , white: fixed parameter set (parameters from com unit are ignored) , white flashing: requests parameters from com unit Status LED (1-4) red: line fault (lead breakage or short circuit)
Coding	optional mechanical coding via front socket
<b>Directive conformity</b>	
Electromagnetic compatibility	
Directive 2014/30/EU	EN 61326-1:2013
<b>Conformity</b>	
Electromagnetic compatibility	NE 21:2007
Degree of protection	IEC 60529:2000
Environmental test	EN 60068-2-14:2009
Shock resistance	EN 60068-2-27:2009
Vibration resistance	EN 60068-2-6:2008
Damaging gas	EN 60068-2-42:2003
Relative humidity	EN 60068-2-78:2001
<b>Ambient conditions</b>	
Ambient temperature	-20 ... 60 °C (-4 ... 140 °F)
Storage temperature	-25 ... 85 °C (-13 ... 185 °F)
Relative humidity	95 % non-condensing
Shock resistance	shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18
Vibration resistance	frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration ± 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration ± 1 mm/0.7 g; 90 minutes at each resonance
Damaging gas	designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3
<b>Mechanical specifications</b>	

Release date: 2023-06-13 Date of issue: 2023-06-13 Filename: 239059\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

 Pepperl+Fuchs Group  
www.pepperl-fuchs.com

 USA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.com

 Germany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.com

 Singapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com


 **PEPPERL+FUCHS**

**Technical Data**

Degree of protection	IP20 (module) , a separate housing is required acc. to the system description		
Connection	removable front connector with screw flange (accessory) wiring connection via spring terminals (0.14 ... 1.5 mm <sup>2</sup> ) or screw terminals (0.08 ... 1.5 mm <sup>2</sup> )		
Mass	approx. 750 g		
Dimensions	57 x 107 x 132 mm (2.2 x 4.2 x 5.2 inch)		
<b>Data for application in connection with hazardous areas</b>			
EU-type examination certificate	BVS 12 ATEX E 015 X		
Marking	Ⓢ II 2(1) G Ex d [ia Ga] IIC T4 Gb Ⓢ II (1) D [Ex ia Da] IIIC		
Output			
Voltage	U <sub>o</sub>	27 V	
Current	I <sub>o</sub>	87 mA	
Power	P <sub>o</sub>	575 mW (linear characteristic)	
Galvanic isolation			
Output/power supply, internal bus	safe electrical isolation acc. to EN 60079-11:2007 , voltage peak value 375 V		
Directive conformity			
Directive 2014/34/EU	EN IEC 60079-0:2018+AC:2020 EN 60079-1:2014 EN 60079-11:2012		
<b>International approvals</b>			
ATEX approval	BVS 12 ATEX E 015 X		
<b>General information</b>			
System information	The module has to be mounted in appropriate backplanes and housings (FB92**) in Zone 1, 2, 21, 22 or outside hazardous areas (gas or dust). Here, observe the corresponding EC-type examination certificate.		
Supplementary information	EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see <a href="http://www.pepperl-fuchs.com">www.pepperl-fuchs.com</a> .		

**Assembly**

**Front view**

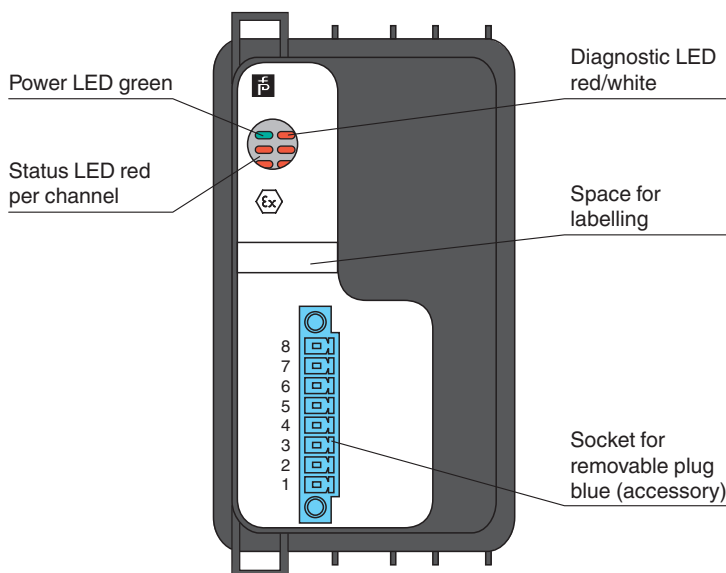

Release date: 2023-06-13 Date of issue: 2023-06-13 Filename: 239059\_eng.pdf