

# Termination Board

## HiDTB04-DVM-IDC1-SC-R1-DI16

- System board for Emerson DeltaV, M-series and S-series
- For one 32-channel DI card via 40-pin Mass Termination Block
- For 4 modules/16 channels
- Recommended module: HiD2844 (DI)
- Volt-free fault indication output
- 24 V DC supply, reverse polarity protected, optional daisychainable
- Hazardous area: screw terminals, blue
- Non-hazardous area: IDC connector, 20-pin



### Function

The function of the termination board and the connector pin assignment is exactly fitted to the requirements of the Emerson DeltaV M-series and S-series.

The signal is output to the process control system via the system connector.

Wiring faults from the field side will be reported via a volt-free relay contact, if this function is supported by the isolated barriers.

The termination board has a robust plastic housing.


The termination board is mounted in the switch cabinet on a 35 mm DIN mounting rail according to EN 60175.

### Application

DeltaV M-series 32-channel DI Series 2 simplex card (24 V DC, dry contact) and DeltaV S-series 32-channel DI simplex card (24 V DC, dry contact):

- Termination board 1 and cable 1: channel 1 ... 16
- Termination board 2 and cable 2: channel 17 ... 32

### Connection

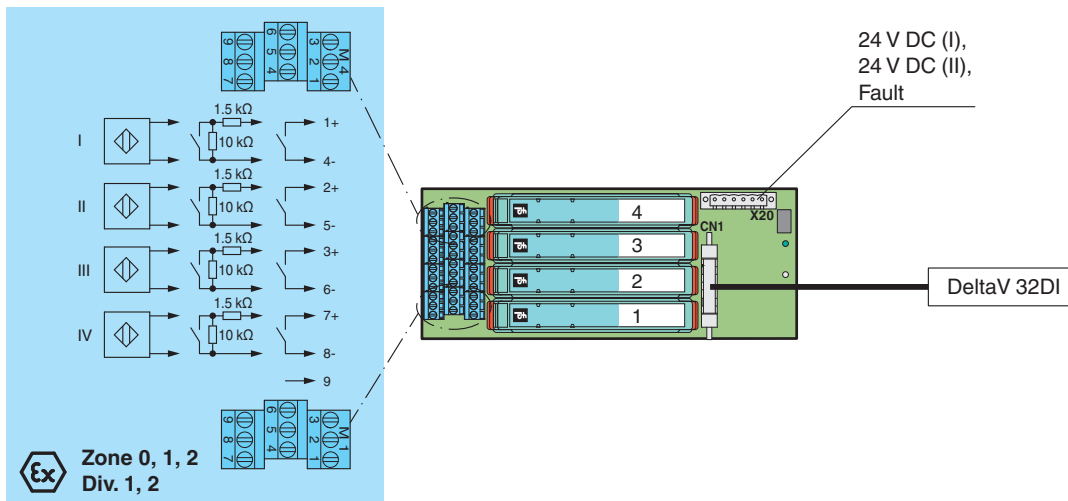

### Technical Data

Supply	
Connection	X20: terminals 1, 3(+); 2, 4(-)
Nominal voltage	24 V DC , in consideration of rated voltage of used isolators
Voltage drop	0.9 V , voltage drop across the reverse polarity protection diode on the termination board must be considered
Ripple	≤ 10 %

Release date: 2023-02-20 Date of issue: 2023-02-20 Filename: 253132\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group  
www.pepperl-fuchs.com

USA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com

**PEPPERL+FUCHS**

## Technical Data

Fusing	3.15 A with back-up fuse
Power dissipation	≤ 500 mW , without modules
Reverse polarity protection	yes
<b>Redundancy</b>	
Supply	The supply for the isolators is reverse polarity protected and monitored.
<b>Fault indication output</b>	
Connection	X20: terminals 5, 6
Output type	volt-free contact
Switch behaviour	no fault: relay contact closed module fault: relay contact open
Contact loading	max. 30 V DC / 30 V AC , 1 A
<b>Indicators/settings</b>	
Display elements	LED PWR (power supply), green LED LED FAULT (fault indication), red LED - LED lits: module fault
<b>Directive conformity</b>	
Electromagnetic compatibility	
Directive 2014/30/EU	EN 61326-1:2013 (industrial locations)
<b>Conformity</b>	
Electromagnetic compatibility	NE 21:2012 For further information see system description.
Degree of protection	IEC 60529:2001
<b>Ambient conditions</b>	
Ambient temperature	-20 ... 60 °C (-4 ... 140 °F)
Storage temperature	-40 ... 70 °C (-40 ... 158 °F)
<b>Mechanical specifications</b>	
Degree of protection	IP20
Connection	
Field side	explosion hazardous area: screw terminals , blue
Control side	non-explosion hazardous area: IDC plug, 20-pin
Supply	pluggable screw terminals , black
Fault output	pluggable screw terminals , black
Core cross section	screw terminals: 0.2 ... 2.5 mm <sup>2</sup> (24 ... 12 AWG)
Material	housing: polycarbonate
Mass	approx. 290 g
Dimensions	82 x 205 x 157 mm (3.23 x 8.1 x 6.2 inch) (W x H x D) , depth including module assembly
Mounting	on 35 mm DIN mounting rail acc. to EN 60715:2001
<b>Data for application in connection with hazardous areas</b>	
EU-type examination certificate	SIRA 13 ATEX 2388X
Marking	see certificate
Non-hazardous area	
Maximum safe voltage	250 V (Attention! U <sub>m</sub> is no rated voltage.)
Galvanic isolation	
Field circuit/control circuit	safe electrical isolation acc. to IEC/EN 60079-11, voltage peak value 375 V
Directive conformity	
Directive 2014/34/EU	EN IEC 60079-0:2018+AC:2020 , EN 60079-11:2012
<b>International approvals</b>	
CSA approval	
Control drawing	116-0381
IECEX approval	
IECEX certificate	IECEX CSA 13.0040X
IECEX marking	see certificate
<b>General information</b>	

Release date: 2023-02-20 Date of issue: 2023-02-20 Filename: 253132\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

 Pepperl+Fuchs Group  
www.pepperl-fuchs.com

 USA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.com

 Germany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.com

 Singapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com

 **PEPPERL+FUCHS**

**Technical Data**

Supplementary information

Observe the certificates, declarations of conformity, instruction manuals, and manuals where applicable. For information see [www.pepperl-fuchs.com](http://www.pepperl-fuchs.com).

Release date: 2023-02-20 Date of issue: 2023-02-20 Filename: 253132\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group  
[www.pepperl-fuchs.com](http://www.pepperl-fuchs.com)

USA: +1 330 486 0002  
[pa-info@us.pepperl-fuchs.com](mailto:pa-info@us.pepperl-fuchs.com)


Germany: +49 621 776 2222  
[pa-info@de.pepperl-fuchs.com](mailto:pa-info@de.pepperl-fuchs.com)

Singapore: +65 6779 9091  
[pa-info@sg.pepperl-fuchs.com](mailto:pa-info@sg.pepperl-fuchs.com)



**Application**

**Typical circuit**

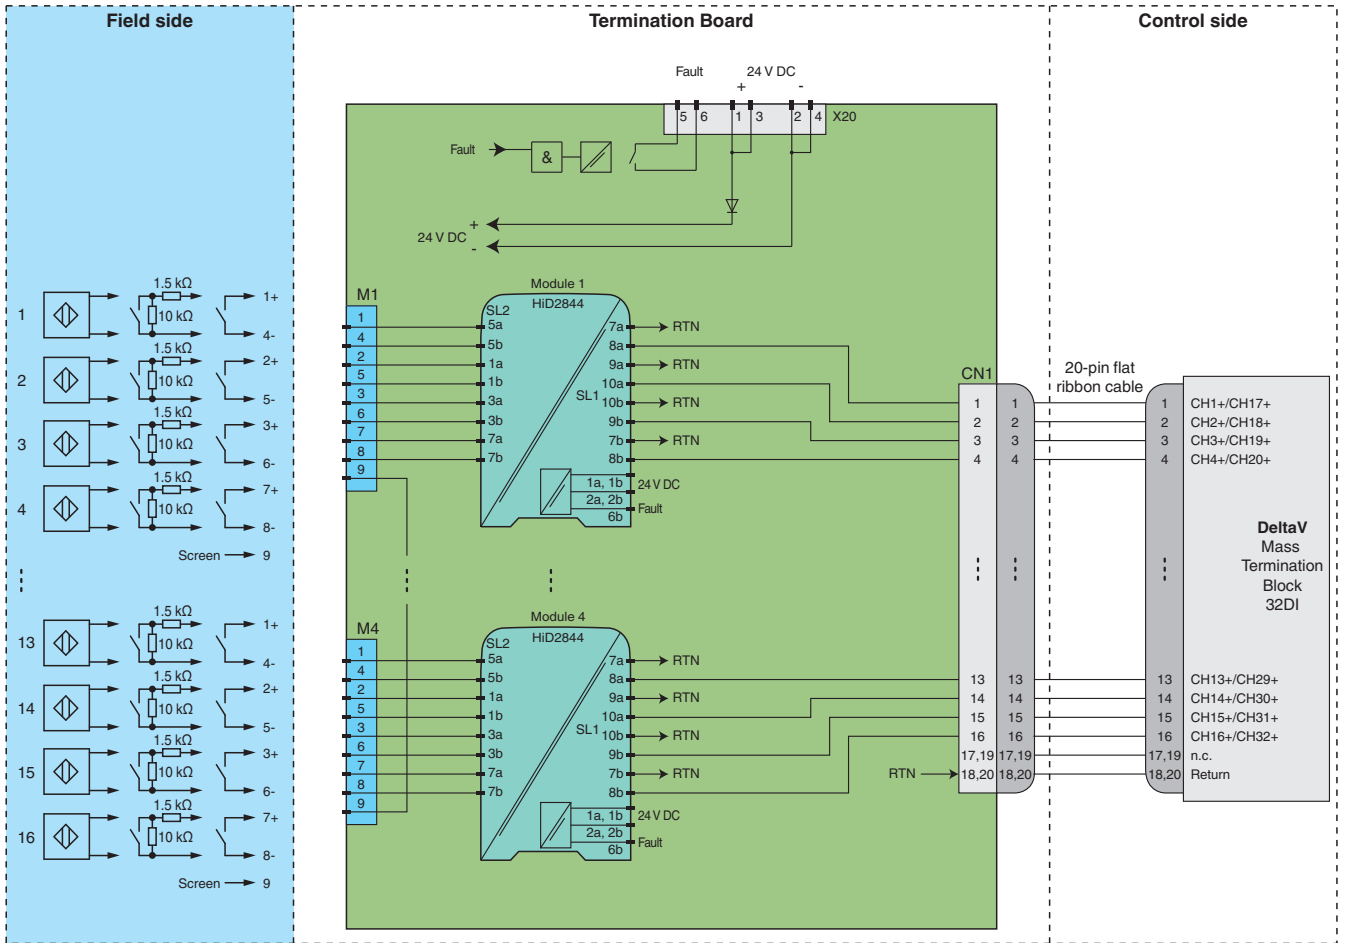

**Module switch settings**

Type (DI)	DIP switch	Position
HiD2844	S1	ON
• Mode of operation: open – energized close – de-energized	S2	ON
• Input line fault detection: enabled	S3	ON
	S4	ON
	S5	ON
	S6	ON
	S7	ON
	S8	ON



For exact pin assignment for connection to field side and control side, see the documentation of the isolated barrier.



The pin-out configuration has to be observed. For information see corresponding pin-out table on [www.pepperl-fuchs.com](http://www.pepperl-fuchs.com).

Release date: 2023-02-20 Date of issue: 2023-02-20 Filename: 253132\_eng.pdf