



## Safety control unit PSE2-SC-02



- Safety control unit
- For evaluating safety thru-beam sensors PSE4-SL
- Safety category 3 according to EN61496-1
- 24 V DC supply voltage
- 1 safe output contact
- Performance level PLd (EN13849-1) is attainable
- Component of PSE4 modular system

Safety control unit from the PSE2/PSE4 series



### Dimensions



### Technical Data

#### Limit data

Permissible cable length	200 m
--------------------------	-------

#### Functional safety related parameters

Performance level (PL)	PL d
Category	Cat. 3
MTTF <sub>d</sub>	109 a
Mission Time (T <sub>M</sub> )	20 a
Diagnostic Coverage (DC)	87 %


#### Indicators/operating means

Operation indicator	LED green: Power on
---------------------	---------------------

## Technical Data

Function indicator		LED green
<b>Electrical specifications</b>		
Operating voltage	$U_B$	24 V DC +20/-10 % 24 V AC $\pm$ 10 %
Power consumption	$P_0$	< 4 W
Surge protection		overvoltage category III
<b>Output</b>		
Signal output		relay, 1 NO
Switching voltage		230 V AC / 24 V DC
Switching current		3 A AC / 4 A DC
Mechanical life		> 10 <sup>7</sup> switching cycles
Response time		18 ms
<b>Output 1</b>		
Output type		Signal output, PNP, open collector
Switching voltage		$U_B - 1$ V
Switching current		max. 50 mA
<b>Conformity</b>		
Functional safety		ISO 13849-1
Product standard		EN 12978 ; ISO 13856-2
<b>Approvals and certificates</b>		
UL approval		cULus Listed File no: NRNT.E344450
TÜV approval		TÜV Rheinland 968/M 301.00/11
<b>Ambient conditions</b>		
Ambient temperature		5 ... 55 °C (41 ... 131 °F)
Pollution degree		2
<b>Mechanical specifications</b>		
Degree of protection		IP20
Connection		screw terminals , lead cross section 2 x 1 mm <sup>2</sup>
Material		PC / PA black
Mass		approx. 150 g

Connection

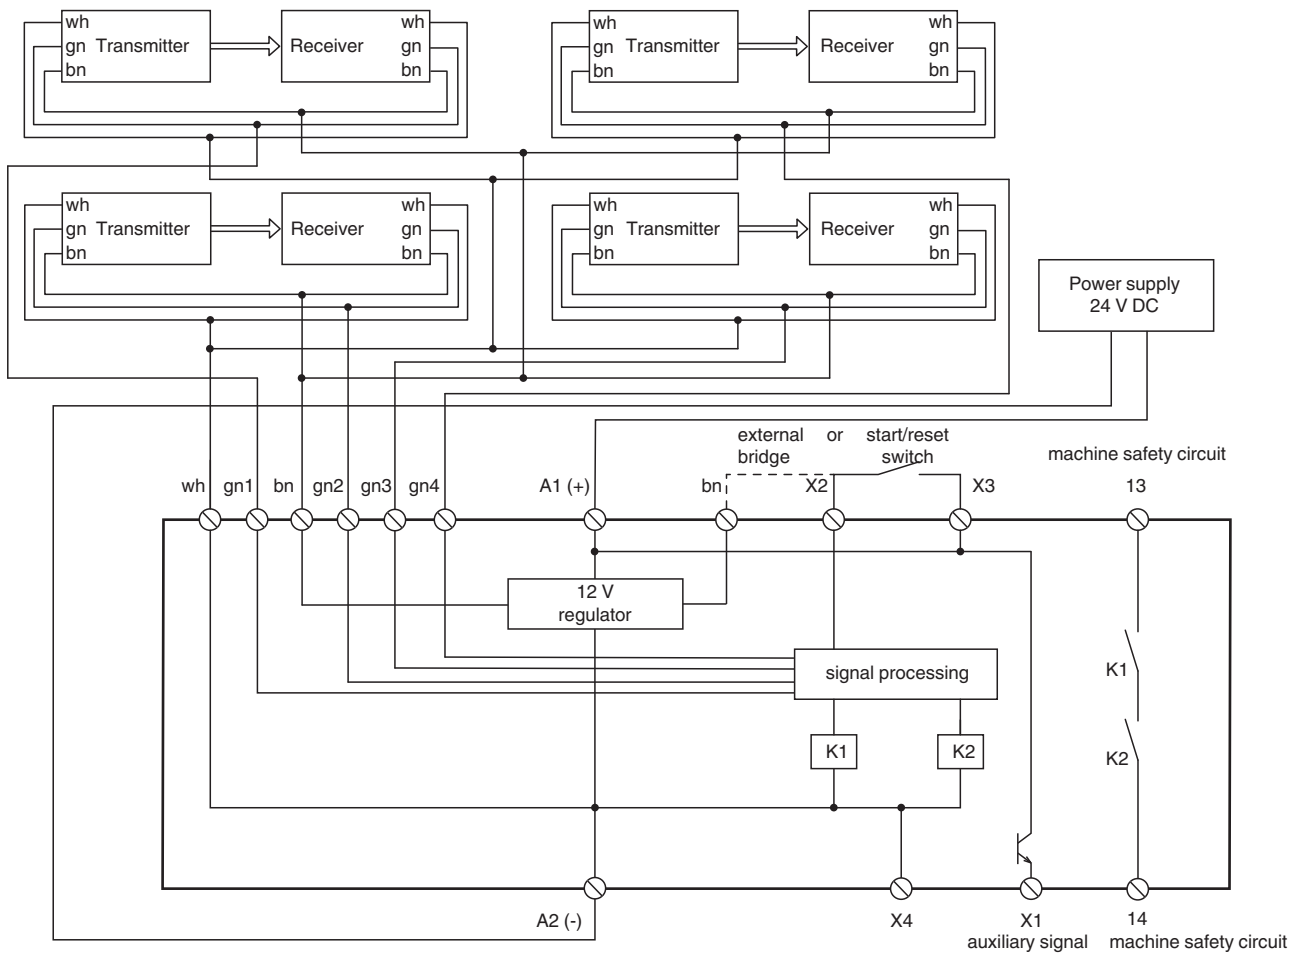

Release date: 2020-10-06 Date of issue: 2020-10-06 Filename: 262534\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group  
www.pepperl-fuchs.com

USA: +1 330 486 0001  
fa-info@us.pepperl-fuchs.com

Germany: +49 621 776 1111  
fa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091  
fa-info@sg.pepperl-fuchs.com

**PF** PEPPERL+FUCHS

**Notes**

**The PSE 2 module is comprised of the following components:**

**Safety thru-beam sensors PSE4-SL:**

The emitter and receiver housings are fully encapsulated to provide maximum protection against environmental influences such as water, dust and moisture and achieve degree of protection IP 68.

**Sensor strips PSE4-RUB and PSE4-ROI:**

The sensor strip has a two chamber design. The emitter and receiver are housed in the round top chamber. When the sensor strip is actuated, the optical channel is interrupted and the safety contacts on the control unit open. When actuation occurs in the end area, the emitter and receiver are pushed into the lower chamber to ensure that the light beam is broken. However, the force required is extremely high and the end areas become inactive as specified in EN 1760-2.

**Safety control unit PSE2-SC:**

The signal from the emitter/receiver system is evaluated as specified in EN ISO /IEC 61496-1 according to control category 3.


**Aluminum rails PSE4-ALU:**

Aluminum mounting rails are available in different lengths.

**Operating principle**

The emitter transmits pulses of infrared light, which are detected by the receiver. When the emitter light is detected, the receiver turns off the emitter via a control input. The "optical emission" stops. The receiver also detects this status and the emitter is then switched on again after a specified time. This coupling generates a dynamic signal sent to a buffer. The evaluation analyzes the charge state of the buffer.

Any errors in the emitter/receiver system affect the optical or electrical signal, which results in the absence of a dynamic signal.

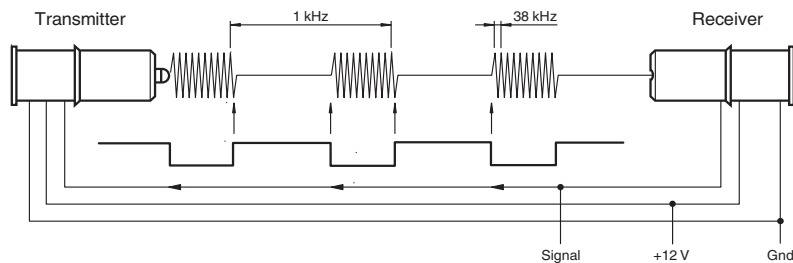

**Note:**

Only fully fitted safety edges comply with the examination certificate for the PSE2 series.

**Possible combinations**


	PSE4-ALU-*	PSE4-ALU-3009-*	PSE4-ROI-*	PSE4-RUB-*	PSE4-RUB-30EPDM58-*	PSE2-SC-*	PSE4-SC-*	PSE4-SL-*
PSE4-ALU-*			X	X	-	X	X	X
PSE4-ALU-3009-*			-	-	X	X	X	X
PSE4-ROI-*	X	-				X	X	X
PSE4-RUB-*	X	-				X	X	X
PSE4-RUB-30EPDM58-*	-	X				X	X	X
PSE2-SC-*	X	X	X	X	X			X
PSE4-SC-*	X	X	X	X	X			X
PSE4-SL-*	X	X	X	X	X	X	X	

**Mounting**


**Mounting or replacing the sensors**

Release date: 2020-10-06 Date of issue: 2020-10-06 Filename: 262534\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

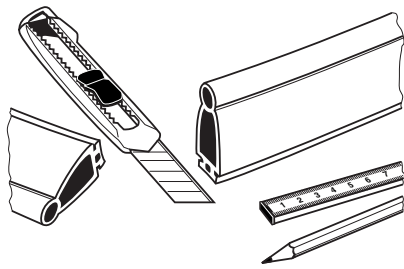

Sensor strip PSE4-RUB-XX or PSE4-ROI-XX and accompanying aluminum mounting strip  
Cut PSE4-ALU-XX to the required length.

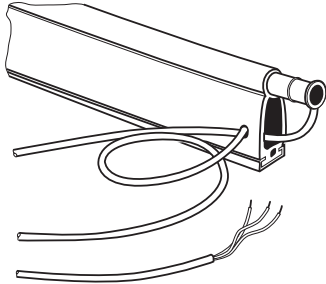

Slide the emitter and receiver into the upper chamber.  
Guide the emitter cable through the lower chamber to the receiver side.

## Accessories

Other suitable accessories can be found at [www.pepperl-fuchs.com](http://www.pepperl-fuchs.com)

## Function

This control interface works with the PSE4 Series and as a complete system consists of the control unit, sensors, a rubber sensor strip, and an optional aluminum mounting strip.

The system has been tested within a temperature range of 5 °C to 55 °C in line with EN 1760-2 and is suitable for finger protection.

The control interface analyzes the signal from the sensors and is designed to be installed in a switch cabinet. The safety contact of the control interface is released by actuating the safety edge.

With this control interface, the system as a whole meets the requirements for performance level d, cat. 3 in accordance with EN ISO 13849-1.