

# Digital Output with Shutdown Input FB2213ER




- 1 digital output, 2 digital inputs
- Inputs and output Ex ia
- Installation in suitable enclosures in Zone 1
- Module can be exchanged under voltage (hot swap)
- Positive or negative logic selectable
- Simulation mode for service operations (forcing)
- Line fault detection (LFD)
- Permanently self-monitoring
- Output with watchdog
- Output with bus-independent safety input



## Function

The digital output features 1 output with 2 feedback inputs.  
 The device can be used to switch solenoids, sounders, or indicators (without line fault detection) in the field. Furthermore, the device accepts digital input signals of NAMUR sensors or mechanical contacts from the field.  
 The output can be switched off via a contact. This can be used for bus-independent safety applications.  
 Open and short-circuit line faults are detected.  
 The intrinsically safe inputs and the output are galvanically isolated from the bus and the power supply.

## Connection

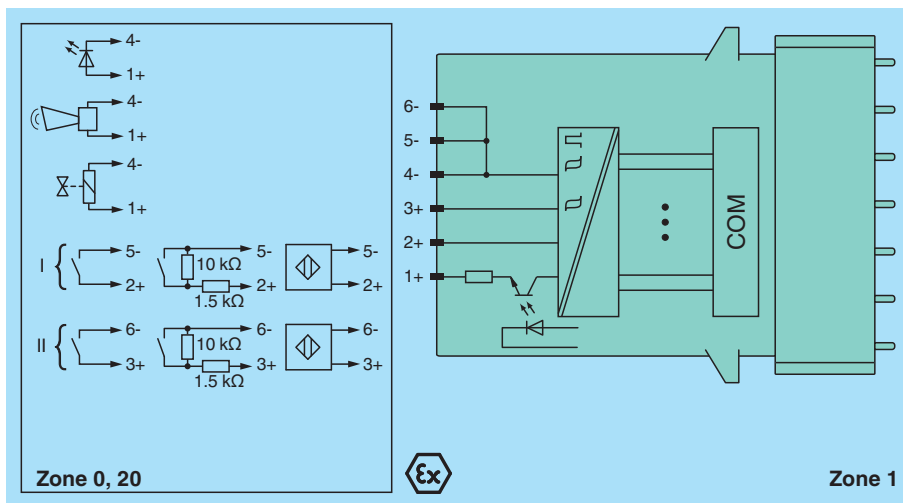

## Technical Data

<b>Slots</b>		
Occupied slots	1	
<b>Functional safety related parameters</b>		
Safety Integrity Level (SIL)	SIL 2	
<b>Supply</b>		
Connection	backplane bus	
Rated voltage	$U_r$	12 V DC , only in connection with the power supplies FB92**
Power dissipation	1.5 W	
Power consumption	1.5 W	
<b>Internal bus</b>		

Release date: 2023-06-13 Date of issue: 2023-06-13 Filename: 301653\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group  
www.pepperl-fuchs.com

USA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com

**PF** PEPPERL+FUCHS

## Technical Data

Connection		backplane bus
Interface		manufacturer-specific bus to standard com unit
<b>Digital input</b>		
Number of channels		2
Sensor interface		
Connection		NAMUR sensor
Connection [2]		volt-free contact
Connection [3]		active binary signal 24 V DC
Connection		channel I: 2+, 5-; channel II: 3+, 6-
Rated values		acc. to EN 60947-5-6 (NAMUR)
Switching point/switching hysteresis		1.2 ... 2.1 mA / ± 0.2 mA
Internal resistor	$R_i$	1 k $\Omega$
Line fault detection		can be switched on/off for each channel via configuration tool
Connection		mechanical switch with additional resistors (see connection diagram) proximity switches without additional wiring
Short-circuit		< 360 $\Omega$
Open-circuit		< 0.35 mA
Minimum pulse duration		1 ms
<b>Digital output</b>		
Number of channels		1
Suitable field devices		
Field device		Solenoid Valve
Field device [2]		audible alarm
Field device [3]		visual alarm
Connection		channel I: 1+, 4-
Internal resistor	$R_i$	509 $\Omega$
Current limit	$I_{max}$	40 mA
Open loop voltage	$U_s$	26.7 V
Line fault detection		can be switched on/off for each channel via configuration tool , also when turned off (every 2.5 s the valve is turned on for 2 ms)
Short-circuit		< 200 $\Omega$
Open-circuit		> 6 k $\Omega$
Response time		20 ms (depending on bus cycle time)
Watchdog		within 0.5 s the device goes in safe state, e.g. after loss of communication
<b>Indicators/settings</b>		
LED indication		LED green: supply LED red: output line fault LED yellow: status output
Coding		optional mechanical coding via front socket
<b>Directive conformity</b>		
Electromagnetic compatibility		
Directive 2014/30/EU		EN 61326-1:2013
<b>Conformity</b>		
Electromagnetic compatibility		NE 21
Degree of protection		IEC 60529
Environmental test		EN 60068-2-14
Shock resistance		EN 60068-2-27
Vibration resistance		EN 60068-2-6
Damaging gas		EN 60068-2-42
Relative humidity		EN 60068-2-78
<b>Ambient conditions</b>		
Ambient temperature		-20 ... 60 °C (-4 ... 140 °F)
Storage temperature		-25 ... 85 °C (-13 ... 185 °F)
Relative humidity		95 % non-condensing

Release date: 2023-06-13 Date of issue: 2023-06-13 Filename: 301653\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group  
www.pepperl-fuchs.comUSA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.comGermany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.comSingapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com


**PEPPERL+FUCHS**

## Technical Data

Shock resistance	shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18	
Vibration resistance	frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration $\pm 0.075$ mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration $\pm 1$ mm/0.7 g; 90 minutes at each resonance	
Damaging gas	designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3	
<b>Mechanical specifications</b>		
Degree of protection	IP20 (module) , a separate housing is required acc. to the system description	
Connection	removable front connector with screw flange (accessory) wiring connection via spring terminals (0.14 ... 1.5 mm <sup>2</sup> ) or screw terminals (0.08 ... 1.5 mm <sup>2</sup> )	
Mass	approx. 350 g	
Dimensions	28 x 107 x 132 mm (1.1 x 4.2 x 5.2 inch)	
<b>Data for application in connection with hazardous areas</b>		
EU-type examination certificate	PTB 97 ATEX 1074 U	
Marking	Ⓢ II 2(1) G Ex d [ia Ga] IIC Gb Ⓢ II (1) D [Ex ia Da] IIIC	
<b>Input</b>		
Voltage	U <sub>o</sub>	14.1 V
Current	I <sub>o</sub>	16 mA
Power	P <sub>o</sub>	55 mW (linear characteristic)
Internal capacitance	C <sub>i</sub>	1.65 nF
<b>Output</b>		
Voltage	U <sub>o</sub>	28.7 V
Current	I <sub>o</sub>	68 mA
Power	P <sub>o</sub>	485 mW
Internal capacitance	C <sub>i</sub>	1.65 nF
<b>Galvanic isolation</b>		
Input/power supply, internal bus	safe electrical isolation acc. to EN 60079-11, voltage peak value 375 V	
Output/power supply, internal bus	safe electrical isolation acc. to EN 60079-11, voltage peak value 375 V	
<b>Directive conformity</b>		
Directive 2014/34/EU	EN IEC 60079-0:2018+AC:2020 EN 60079-1:2014 EN 60079-11:2012	
<b>International approvals</b>		
ATEX approval	PTB 97 ATEX 1075 ; PTB 97 ATEX 1074 U	
<b>General information</b>		
System information	The module has to be mounted in appropriate backplanes and housings (FB92**) in Zone 1, 2, 21, 22 or outside hazardous areas (gas or dust). Here, observe the corresponding EC-type examination certificate.	
Supplementary information	EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see <a href="http://www.pepperl-fuchs.com">www.pepperl-fuchs.com</a> .	

**Assembly**

Front view

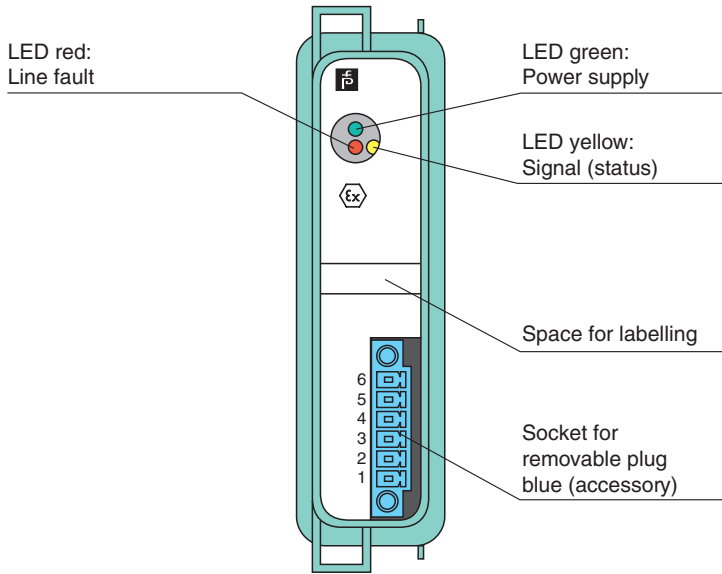


**Load calculation**

$R_{load}$  = Field loop resistance

$$U_e = U_s - R_i \times I_e$$

$$I_e = U_s / (R_i + R_{load})$$


**Characteristic Curve**

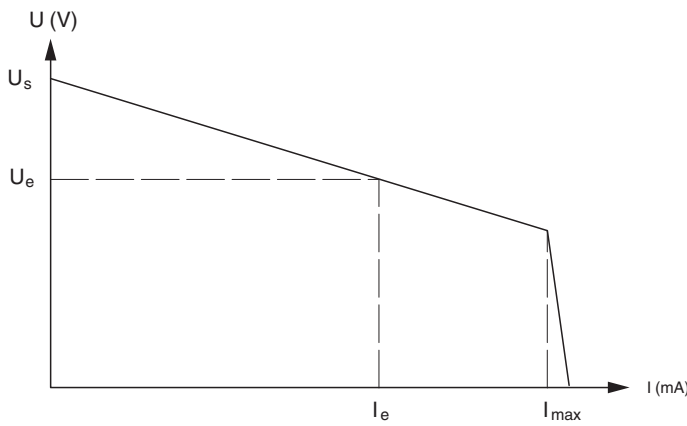

Release date: 2023-06-13 Date of issue: 2023-06-13 Filename: 301653\_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

## Characteristic Curve

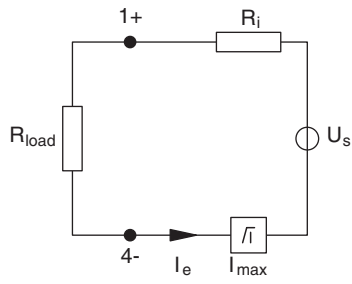

## Accessories

	<p><b>LB9180</b></p>	<p>Watchdog Plug, 1-channel</p>
--	----------------------	---------------------------------