


HART Termination Board

HiSHPTB/32/TR-DO-01




- Triconex 3604E replacement FTA
- Outputs: 2 x 16 channels, 24 V DC, opto-isolated, non commoned
- Short-circuit protected
- Plug-n-play wiring capabilities

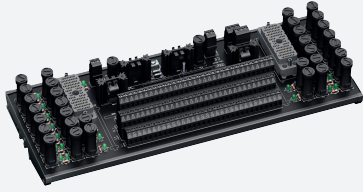

Function

The Termination Board is designed for easy HiDMux2700 Multiplexer integration with the Tricon safety system. With the Multiplexer integrated into the board and plug-n-play option for the DCS equipment, this provides a very clean access to the HART signals, while reducing the need for marshalling cabinets and reducing equipment that require extra cabinet space. The HART Termination Board provides a robust solution for on-line HART communications, interfaces up to 32 field located HART devices, and, it allows the user to replace standard DCS field termination panels.

Connection

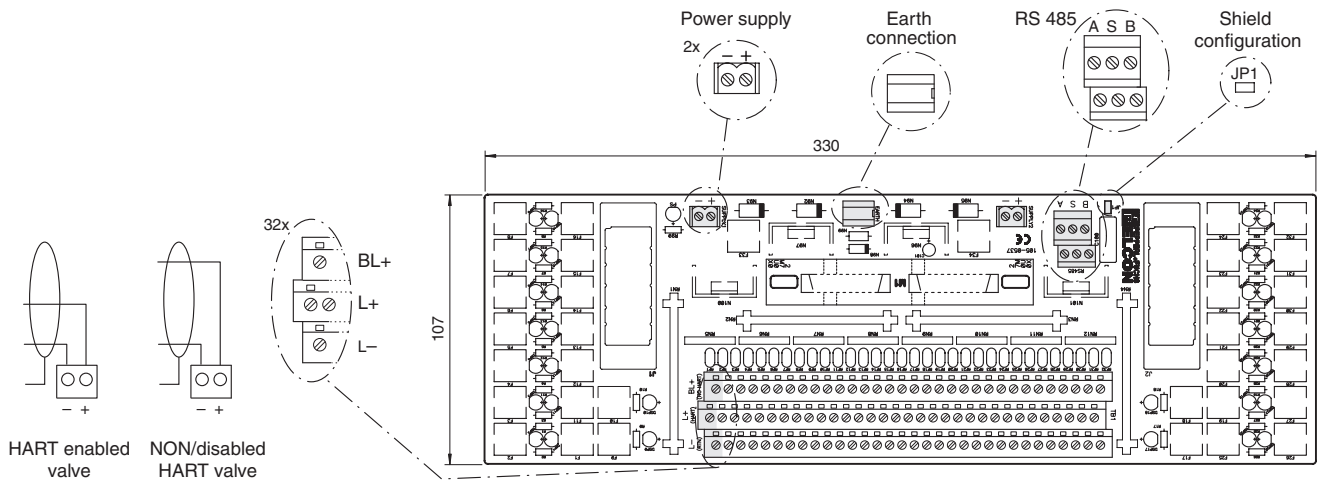

Technical Data

Supply	
Rated voltage	U_r 20 ... 30 V DC
Fusing	3.15 A , 5 x 20 mm (0.2 x 0.8 inch)
Power dissipation	0.7 W , with Multiplexer
Reverse polarity protection	yes
HART signal channels (intrinsically safe)	
HART signal channels	
Number of channels	32 unbalanced signal loops
Redundancy	
Supply	yes
Galvanic isolation	

Release date: 2023-06-01 Date of issue: 2023-06-01 Filename: 908121_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

PEPPERL+FUCHS

Technical Data

HART signal channels	30 V DC
Ambient conditions	
Ambient temperature	0 ... 55 °C (32 ... 131 °F)
Relative humidity	5 ... 90 %, non-condensing
Mechanical specifications	
Core cross section	2.5 mm ² (16 AWG)
Connection	field side: screw terminals control side: 56-pin Elco connector RS 485 interface: removable screw terminals power: removable screw terminals
Mass	approx. 500 g
Dimensions	333 x 125 x 208 mm (13.1 x 4.9 x 8.2 inch) (W x H x D) , depth including module assembly with HiDMux2700
Mounting	DIN rail mounting
General information	
Supplementary information	Observe the certificates, declarations of conformity, instruction manuals, and manuals where applicable. For information see www.pepperl-fuchs.com .

Additional Information

Connection Assignment

Connector	Channel
J1	1 ... 16
J2	17 ... 32

Configuration

Jumper	Analog input	Galvanic grounding	Capacitive grounding
JP1	RS-485	closed	opened

Interface

Triconex I/O interface

- 3604E