



Type Y &Z purge and pressurization system

3003

- NFPA 496, ISA 12.4
- Optional alarm output indicates air lock failure
- Optional differential pressure switch for Class I, Group A-D, hazardous area locations
- Type Y system certified for Class I, Division 1 to Division 2
- Type Z system certified for Class I, Division 2 to nonhazardous area
- Enclosure volume up to 2.54 m³ (90 ft³)

3003 Series purge and pressurization system





Function

The model 3003 is a Rapid Exchange®- purging system that operates on a supply of compressed instrument air or inert gas. The system regulates and monitors pressure within sealed protected enclosure(s), in order to remove and prevent flammable gas or vapor

The system regulates and monitors pressure within sealed protected enclosure(s), in order to remove and prevent flammable gas or vapor accumulations.


The system accomplishes the required volume exchanges and maintains a safe pressure. A Pepperl+Fuchs Model EPV-3 enclosure protection vent is required for proper operation.


This process reduces the hazardous (classified) area rating within protected enclosure(s), in accordance with the NEC - NFPA 70, NFPA 496, ISA

Connection

WPS


Terminal block connections






WPSA

Terminal block connections

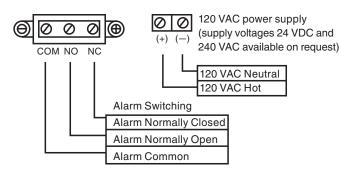

Wiring configuration



Technical Data

General specifications		
Series	3003 Series	
Hazardous environment	gas	

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Technical Data

reominar Bata	
Electrical specifications	
Connection	Terminal blocks
Output	
Output I	-WPS-
Output type	Switch contacts
Contact loading	120 VAC @ 15 A
Output II	-WPSA-
Output type	Switch contacts
Contact loading	120/220 VAC; 24 VDC @ 10 A; 125 VDC @ 50 mA power requirements: 24 / 120 / 240 VDC @ 3 / 4 / 11 watts
Pneumatic parameters	
Protective gas supply	instrument grade air or inert gas
Pressure requirement	80 - 120 psi (5.5 - 8.3 bar)
Safe pressure	Setpoint: 0.25" (6.35 mm) Flow rate: 0.1 - 3.5 SCFH (2.8 - 99 l /hr)
Purge flow and enclosure pressure rate	12 SCFM /720 SCFH (340 I /m / 20390 I /hr) (With regulator set to 60 psi min. during exchange)
Operating conditions	
Process conditions	
Exchange time	4 volume exchange rate: 1 min / 3.0 ft ³ (85 l/min) 5 volume exchange rate: 1 min / 2.4 ft ³ (68 l/min)
Ambient conditions	
Ambient temperature	-29 49 °C (-20.2 120.2 °F)
Mechanical specifications	
Connection type	System supply port: 1/4" FPT Enclosure supply port: 1/2" FPT Enclosure reference fitting: 1/4" tube Switch conduit port size: 1/2" FPT
Material	Regulator body: zinc w/enamel finish Regulator handle &bowl: polycarbonate Enclosure pressure gauge: alum. w/enamel finish Rapid Exchange® gauge: poly &nickel plated Tube fitting: 316 SS forged body Tubing: 316 SS 1/4" .035 welded Fastener hardware: alum. &stainless steel System face plate: 316 14 ga #3 brush SS System mounting flange: 316 SS tumble finish Manifold body: anodized aluminum Manifold valves: 316 SS Mfr. ID nameplate: silkscreen Lexan®
Mass	3003-LPS-* 4.5 kg (10 lb) 3003-WPS* 6.8 kg (15 lb)
International approvals	
FM approval	Type Y LPS: Class I, Division 1, Groups A, B, C, D WPS: Class 1, Division 1, Groups C, D WPSA: Class I, Division 1, Groups A, B, C, D Type Z LPS: Class I, Division 2, Groups A, B, C, D WPS: Class 1, Division 2, Groups C, D WPSA: Class I, Division 2, Groups A, B, C, D
UL approval	
cULus	Type Y LPS: Class I, Division 1, Groups A, B, C, D WPS: Class 1, Division 1, Groups C, D WPSA: Class I, Division 1, Groups A, B, C, D Type Z LPS: Class I, Division 2, Groups A, B, C, D WPS: Class 1, Division 2, Groups C, D WPSA: Class I, Division 2, Groups A, B, C, D

5PEPPERL+FUCHS

Mounting

VM configuration mounting options



Model 3003-LPS-CI-YZ-VML Flange mounted to flat vertical surface with Model SMK-1 fastener kit



Model 3003-LPS-CI-YZ-VML Flange mounted to vertical 2" pipe stand with Model PMK-1 fastener kit



Model 3003-LPS-CI-YZ-VM Frame or panel* mounted through cutout in suitable surface with Model SMK-6m

HM configuration mounting options



Model 3003-LPS-CI-YZ-HMT Flange mounted to flat horizontal surface with Model SMK-1 fastener kit



Model 3003-LPS-CI-YZ-HMB Flange mounted to horizontal 2" pipe stand with Model PMK-1 fastener kit



Model 3003-LPS-CI-YZ-HM Frame or panel* mounted through cutout in suitable surface with Model SMK-6m fastener kit

CK configuration mounting options



Front view




Rear view

Model 3003-LPS-CI-YZ-CK
Rear vew of frame or panel* mount through cutout in suitable surface with supplied fasteners


Assembly

Additional Information

External Mount

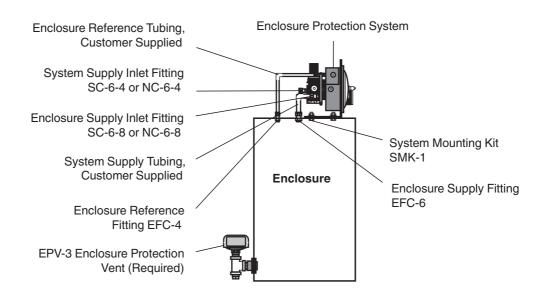


Internal Mount

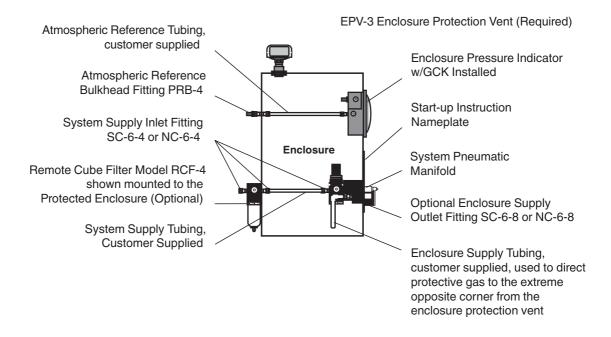


Required enclosure protection vent


Panel Mount Installation Diagram

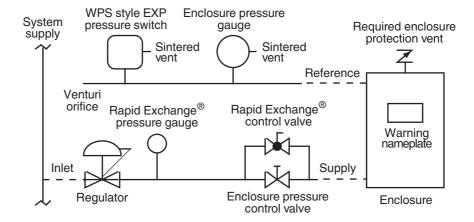

3003-LPS-CL-**-VM*-**-****


3003-LPS-CL-**-HM*-**-****






3003-WPS*-CL-**-VM*-**-****

3003-WPS*-CL-**-HM*-**-****



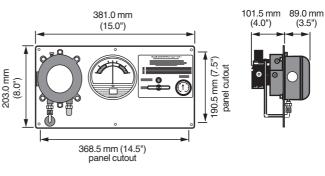



Component kit

Pneumatic manifold

Enclosure pressure gauge









Type Y &Z purge and pressurization system

Accessories

System Accessories		
Connection fittings		
Part	Description	
NC-6-4	3/8" T x 1/4" P ninety connector	
SC-6-4	3/8" T x 1/4" P straight connector	
NC-6-8	3/8" T x 1/2" P ninety connector	
SC-6-8	3/8" T x 1/2" P straight connector	
EFC-4	1/4" flush connector	
EBC-4	1/4" bulkhead connector	
EFC-6	3/8" flush connector	
EBC-6	3/8" bulkhead connector	
EPC-13	1 - 1/4" pipe connector	
Additional items		
Part	Description	
SMK-1	Surface Mounting Kit - Flange	
SMK-6m	Surface Mounting Kit - Frame/Panel	
PMK-1	Pipe Mounting Kit	
GCK	Gauge Conversion Kit	
ILF-4	1/4" In-Line Filter Kit	
RCF-4	1/4" Remote Cube Filter	
EPSK-1	Explosion Proof Switch Kit (GRP C, D)	
EPSK-1A	Explosion Proof Switch Kit (GRP A-D)	
GPSK-1	General-purpose Switch Kit	
RAH	Remote Alarm Horn	
RAB-1	Div. 1 Remote Alarm Beacon	
RAB-2	Div. 2 Remote Alarm Beacon	
Warning nameplates		
Part	Description	
EWN-1	Class I enclosure warning	
ETW	Enclosure temperature warning	
Installation & Operation Manual		
Part	Description	
DOCT-1369	Installation and Operation Manual	

Type Code

S

CLL

3

Z